




GERAND ENGINEERING

2300 EDGEWOOD AVE S, MINNEAPOLIS, MN 55426
952.374.1320 WWW.GERAND.COM

FIRE PUMP TEST METER K-4500-10

CONSTRUCTION & SPECIFICATIONS

MATERIALS:	CA36 ASTM B16 BRASS
VALVES:	RATED AT 600 WOG VALVE BODY: CAST BRONZE ASTM B584 TAIL PIECE: CA-360 B-16 BALL: BRASS CA-360 HARD CHROME P LATED SEALS: REINFORCED PTFE, 15% GLASS FILLED HANDLE: STEEL ASTM B633 W/ZINC PLATING
BRASS FITTING:	PIPE NIPPLE - B16 / 1/8" NEEDLE VALVE-B16 DISCONNECTS-B16
ID TAG:	CHAIN: BRASS TAG: ALUMINUM -3.21" THICK #200 MILL SET SCREW: STEEL ZINC PLATED
HOSES:	GOODYEAR 3/16" FREON CHARGING HOSES WITH NYTRIEE CORE, POLYESTER BRAID AND NYTRILE COVER WITH PVC FOR ABRASION RESISTANCE.

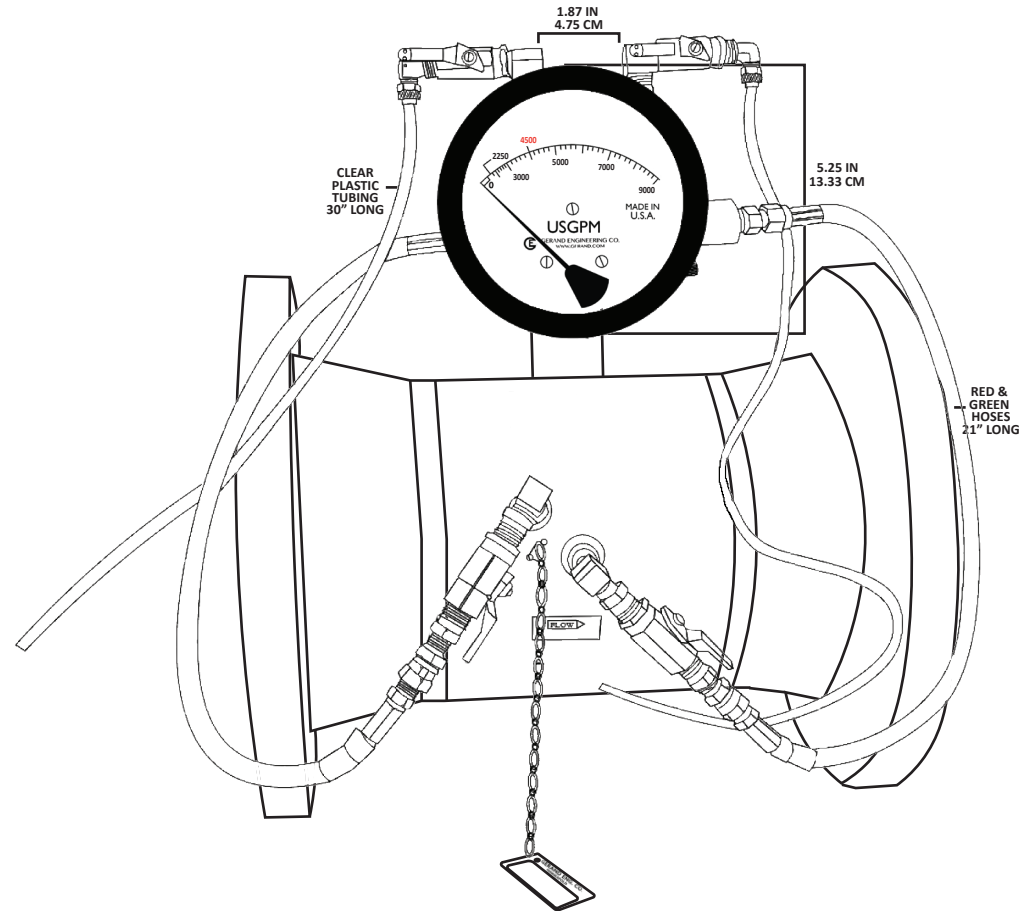


METER DATA

CONSTRUCTION:	ALUMINUM BODY
OPERATION:	BUNA "N" DIAPHRAGM
ACCURACY:	±2.0%
TEMPERATURE:	200° F MAX
PRESSURE:	1500 PSI MAX
APPROX. WEIGHT:	3 LBS/EACH

4 1/2" DIAL STANDARD - 6" AVAILABLE

WELD-NECK FLANGES
RAISED FACE

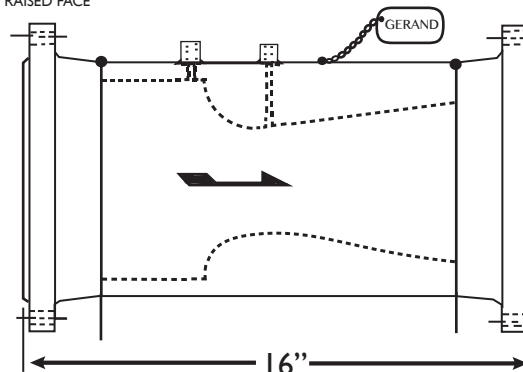

WEIGHTS & DIMENSIONS

WEIGHT:	181 LBS
SHIPPING DIMENSIONS:	33" x 33" x 29" with PALLET