




GERAND ENGINEERING CO.

2300 EDGEWOOD AVE S, MINNEAPOLIS, MN 55426 952.374.1320 WWW.GERAND.COM

CALIBRATION of VENTURIS

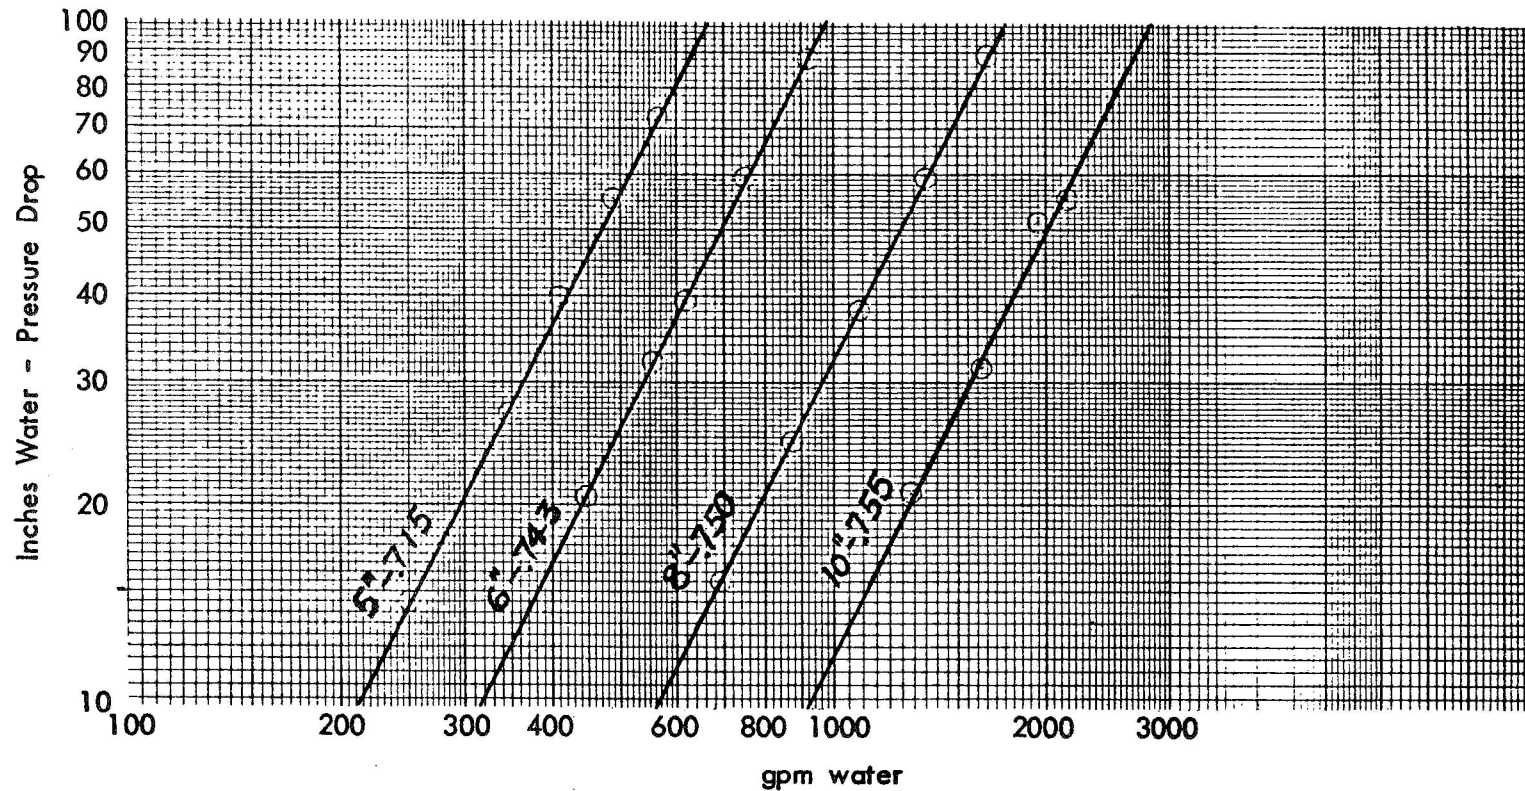

NOTE:

Figures on the graph indicate pipe diameter in inches and the ratio of throat diameter to pipe diameter.

Abscissa is flow rate of water in gallons per minute.

Ordinate is pressure difference between two measuring tops.

The curve of the Venturis show above were determined by weight of water.

